


Détails des connexions de mise à la terre / Dettaglio di connessioni di circuito di protezione e di terra

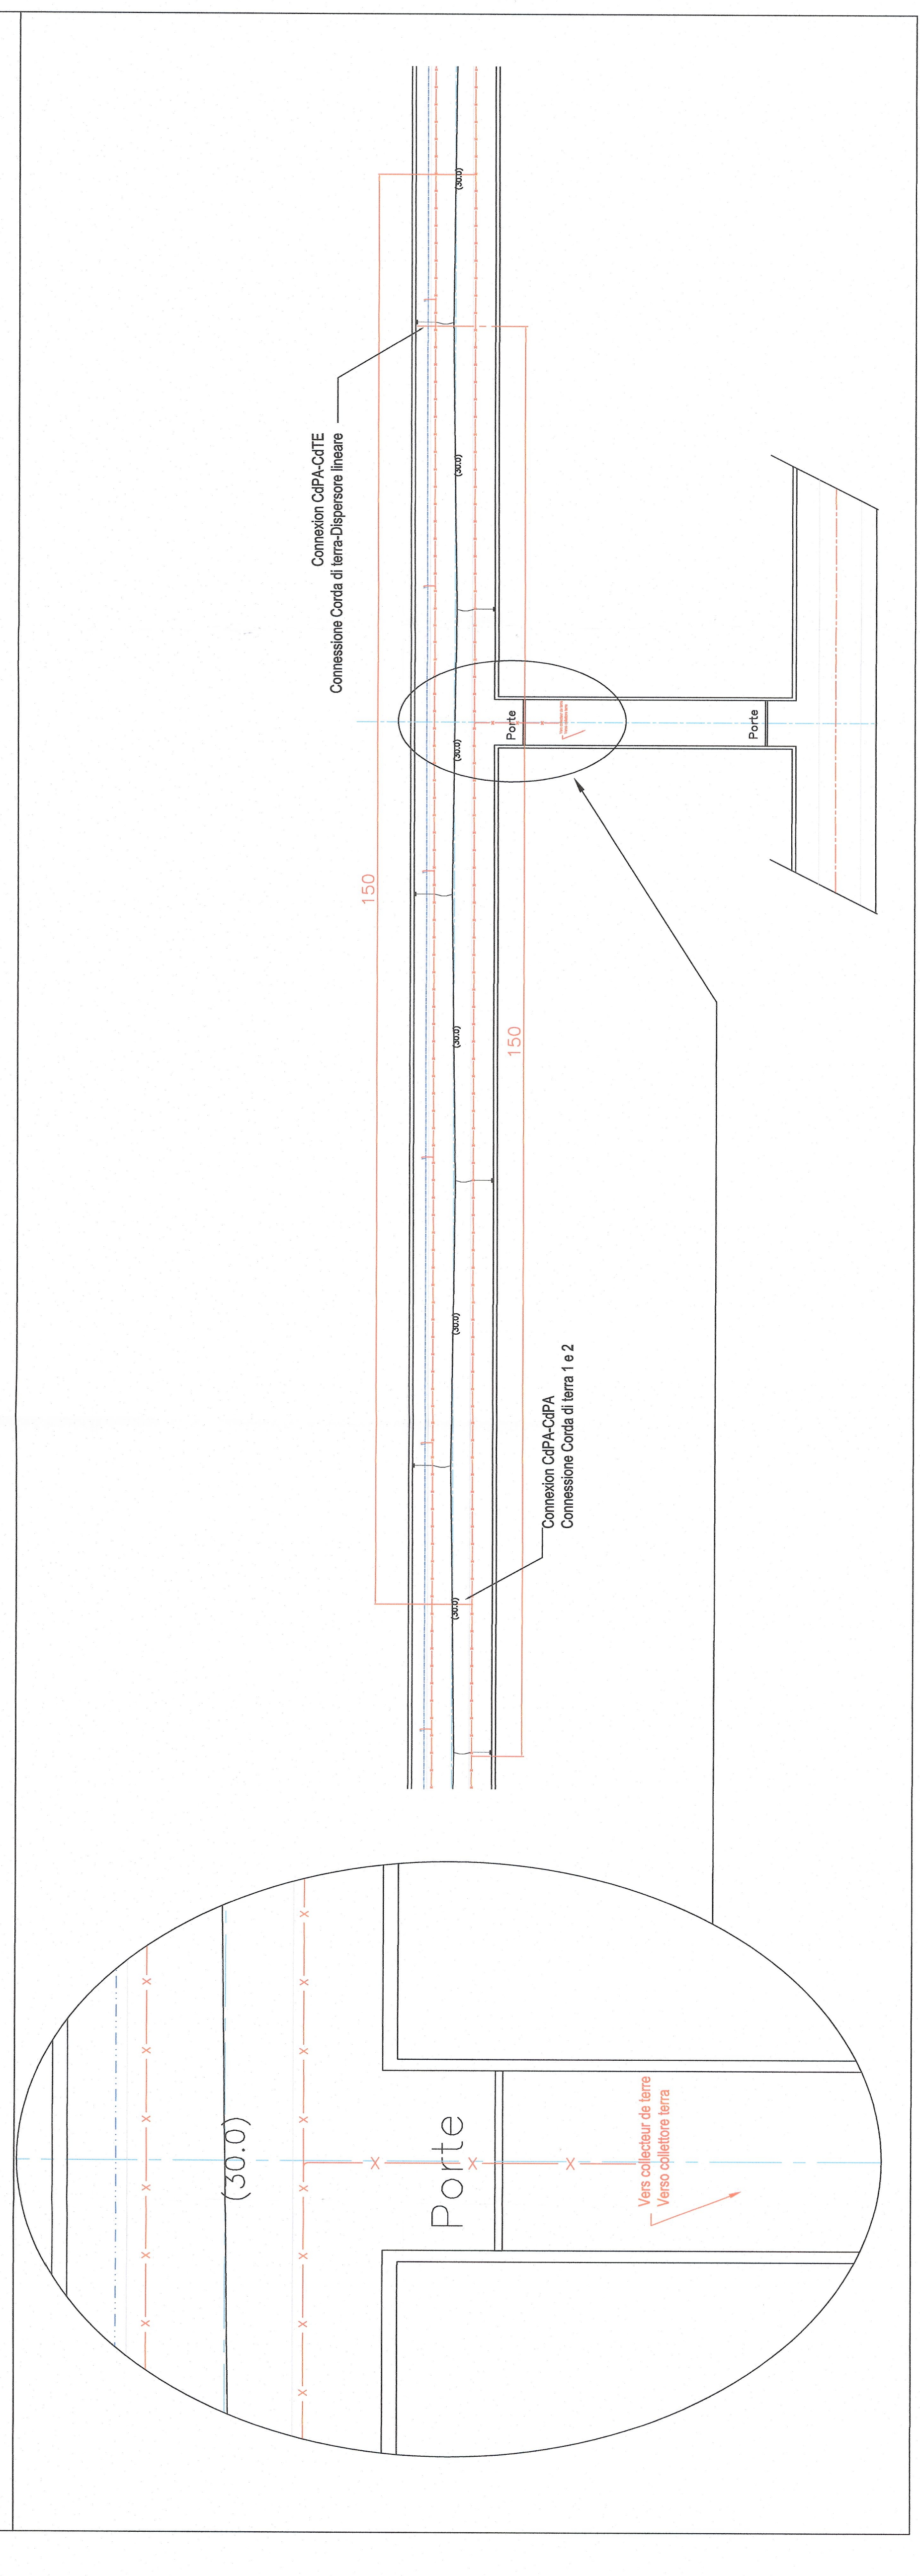

Items nécessaires pour une section type tunnel de 1600 m unitaire de longueur

Regle	Quantité (pour 1600m)	Unité	Quantité (pour 1600m)
(ENS. = ASSEMBLÉ)			
1	1	u	1
2	58	u	58
3	1850	m	1850
4	1800	m	1800
5	1800	m	1800
6	3300	m	3300
7	3300	m	3300
8	11	u	11
9	2	u	2
10	4	u	4
11	1	u	1
12			
MATERIALE			
Quantité (pour 1600m)			
1	1	u	1
2	58	u	58
3	1850	m	1850
4	1800	m	1800
5	1800	m	1800
6	3300	m	3300
7	3300	m	3300
8	11	u	11
9	2	u	2
10	4	u	4
11	1	u	1
12			

Code	Des	Quantité	Unité	Code	Des	Quantité	Unité
P	1	1	u	A	1	1	u
D	2	2	u	B	1	1	u
C	3	3	u	C	1	1	u
B	4	4	u	D	1	1	u
T	5	5	u	E	1	1	u
S	6	6	u	F	1	1	u
3	7	7	u	G	1	1	u
0	8	8	u	H	1	1	u
6	9	9	u	I	1	1	u
1	10	10	u	J	1	1	u
7	11	11	u	K	1	1	u
1	12	12	u	L	1	1	u
B				M	1	1	u
A				N	1	1	u
P				O	1	1	u
D				P	1	1	u
C				Q	1	1	u
B				R	1	1	u
T				S	1	1	u
S				T	1	1	u
3				U	1	1	u
0				V	1	1	u
6				W	1	1	u
1				X	1	1	u
7				Y	1	1	u
1				Z	1	1	u